

# LABOR – ASTER

# INDUSTRIAL AUTOMATION







Intrinsically safe barrier with separation, version with only RS485 on Ex side TRANSMISSION LINES CONVERTER-SEPARATOR type S2Ex-RS v.Ex485

only Rs485 on Ex side: RS232/RS485, RS422/RS485, RS485/RS485



"Group I", "category (M1)" and "group II and III", "category (1)" accompanying device

- EC-Type Examination Certificate: KDB 04ATEX120
- Feature: II (1)G [Ex ia] IIC, II (1)D [Ex ia] IIIC, I (M1) [Ex ia] I

Feature basing on conformity assessment procedure according to ATEX module A: II 3G Ex ec IIC T4, "group II", "category 3" device

Housing protection level IP20 Operating temperature range -30..+70°C

- Intrinsically safe circuit can operate with intrinsically safe transmission line with ia, ib or ic protection level (see page 3 conditions of use) led to explosion hazardous zone "0, 1, 2, 20, 21, 22" of any explosive mixtures and mine undergrounds.
- The second separated transmission side and supply circuit can work with non-intrinsically safe circuits of devices with voltage Um=253V e.g. supplied from 230Vac network.
- The device as accompanying device should be installed in explosion safe zone or in explosion hazardous zone in suitable explosion-proof designed enclosure (see page 3). Atmosphere should be dry, dust free and protected against access of people not trained in maintenance and operation of the device.
- The device can be installed in explosion hazardous zone in "1, 2, 21, 22" and mine undergrounds only in flameproof enclosure Ex d (or another in accordance to the relevant standards). In zone "2" basing on designation Ex 3G ec IIC T4 (category 3 device) it can be also installed basing on other rules – see page 3.

### • Separation and translation of the following transmissions:

Safe zone	Explosion hazardous zone
RS232	
RS485	RS485
RS422	

- The separator is designed between others for MODBUS RTU/ASCII, PROFIBUS DP and operates correctly with any half-duplex protocol.
- Jumpers-selected transmission speed: 9600, 14400, 19200, 38400, 57600, 115200 bd.
- Automatic measurement of transmission speed: 300, 600, 1200, 2400, 4800, 9600, 14400, 19200, 33600, 38400, 57600 bd.
- Supported transmission parameters: 7N2, 7O1, 7O2, 7E1, 7E2, 8N1, 8N2, 8O1, 8O2, 8E1, 8E2<sup>1</sup>.
- Smart control of flow direction.
- All circuits fully galvanically separated.
- Internal lines terminators.
- Led indication of supply, transmission and line damage.

The separator is designed to galvanically separate and translate transmission standards RS232, RS485, RS422 in safe zone to standard RS485 in intrinsically safe circuit leading to hazardous zone. For transmission RS485 and RS422 the separator allows to operate with the transmission line up to 1200 meters (up to 1000m for 57600bd, 600m for 115200bd) and many devices to operate with each other. Separation eliminates interferences and the differences of potentials. It also protects connected devices from power surges. On the intrinsically safe only RS485 side is interface - communication in both direction on two-wire line. On the safe side user can use RS232, RS485 or RS422. Switching requires opening of the housing and switching the jumpers. Switching description is given later in this document.

# **BASIC TECHNICAL PARAMETERS:**

Non-intrinsically safe side RS232 according to RS232C standard Receiver parameters:

- low level -9 V ÷ -3 V - high level  $+3 \text{ V} \div +9 \text{ V}$ 

max 15m for 19200bd Connection line length

(capacity sum C<2500pF) max 5m for 57600bd (C<100pF)

3 bods

<u>Transmitter parameters</u>:

- output voltage minimum ±5V on load R≥3kΩ

**RS485 and RS422** 

- receiver sensitivity - signal from transmitter min. ±2V on load R≥100Ω Connection line length max 1200m for <57600bd max 1000m for 57600bd max 600m for 115200bd

300, 600, 1200, 2400, 4800, Baudrate 9600, 14400, 19200, 33600,

38400, 57600, 115200 Minimal interval between switching or2 15-20 bods

Direction of line switching time <150 ns Distortion of the bit <100 ns Phase shift of the bit <100 nsNumber of devices in the line max 32 PWR LED on Supply indication Transmission indication RS LED blinking 20...28Vdc/60mA Supply

Rail housing IP20 on TS35 rail cable terminals 2.5mm<sup>2</sup> circuits of both sides of transmission Galvanic separation and supply circuit mutually separated

- isolation test voltage Rail housing IP20 with rail 114.5 x 99 x 22.5mm


EMC conformity - directive 2014/30/UE: PN-EN 61326-1

<sup>&</sup>lt;sup>1</sup> 7,8 – bits number, N -no parity bit, O – odd parity, E – even parity, 1 -1 stop bit, 2-2 stop bits

<sup>&</sup>lt;sup>2</sup> Depending on the position of jumper SV5A 6-7 and lack of transmission control








View of the front side of the S2Ex-RS separator

Block diagram of the S2Ex-RS vEx.485 separator



Housing dimensions: thickness 22.5 mm; width 99 mm, height 114.5 mm.

NOTE: Terminal GND1 in intrinsically safe circuit allows connecting shield of the transmission cable which goes to explosion hazardous zone. Braid of the shielded cable cannot be grounded from both sides (in safe zone and hazardous zone). Braid does not have to but can be connected to the ground but only from one side. If GND1 terminal together with cable shield is grounded in safe zone then braid of the cable in explosion hazardous zone must be distanced minimum 5cm from terminals of the core of this cable or insulated with heat shrink tubing.

View of the jumpers comb to switch.

Description of the jumpers configuration is in the table on page 5.

# **SAFETY PARAMETERS:**

ATEX conformity - directive 2014/34/UE: PN-EN 60079-0, PN-EN 60079-11, PN-EN 60079-7

a) Intrinsically safe circuit: terminals T-B1, A1, B1, GND1 with "ia" protection level:

Distributed values of Co, Lo, L/R of the connection cable should be adopted according to the table shown below.

	Uo	Io	Po	L	/R [mH/Ω	2]		Lo [mH]			Co [µF]	
Version	[V]	lo [mA]	[mW]	I and IIA	IIB and III	IIC	I and IIA	IIB and III	IIC	I and IIA	IIB and III	IIC
S2Ex-RS-1		139	171	1,66	0,83	0,20	30	12	3,2	800	800	80
S2Ex-RS-2		141	174	1,64	0,82	0,20	30	12	2,1	800	800	80
S2Ex-RS-3	5	159	195	1,45	0,72	0,18	20	7	3,5	700	700	70
S2Ex-RS-4		191	236	1,20	0,60	0,15	11	5,2	1,6	600	600	60
S2Ex-RS-5		255	315	0,90	0,45	0,11	8	3,2	0,9	500	500	50

Characteristic of the circuits is linear. For clustered values should be taken half of the values of Co, Lo given in this table remembering that Co cannot exceed  $1\mu F$  for group I, IIA, IIB and  $0.6\mu F$  for IIC.

## b) Intrinsically safe circuit parameters: terminals T-B1, A1, B1, GND1

with "ia" protection level:  $Li \cong 0$ ,  $Ci \cong 0$ .

V	Version	Ui [V]	Ii [mA]	Pi [mW]
S2	Ex-RS-1		299	
S2.	Ex-RS-2		290	does not
S2	Ex-RS-3	30	290	require
S2.	Ex-RS-4		290	determination
S2.	Ex-RS-5		290	

# c) Non-intrinsically safe circuits parameters:

terminals "A, B, T-B, Y, Z, GND" and "supply 24V": terminals "ZAS+, ZAS-": Um=253V

Safety parameters for group III (dusts) are the same as for group IIB (gas).

In installations in which parameters Ci and Li of device cooperating with intrinsically safe circuit (connection cable excluded) exceeds 1% of the value of parameters Co and Lo given in the table above you should:

- from 50% of the value of Co, Lo subtract Ci, Li of cooperating device,
- these values remains for parameters of connection cable,
- if cable parameters are unknown you can take 200pF/m, 1μH/m for calculation.

#### Conditions of use:

If the intrinsically safe circuits has operated with intrinsically safe circuit with "ic" protection level, it may in the future operate with "ia" or "ib" protection circuits, provided that the device is sent to the manufacturer for technical verification of its "ia" protection level.

The device has a plastic, non-flammable housing and is adapted for mounting on a DIN T35 rail.

In the event of damage, the device cannot be repaired by the end-user and must be returned to the manufacturer or his authorized representative. All unauthorized modifications should be avoided.

The intrinsically safe conductors must be identifiable, separated from non-intrinsically safe ones and wired in accordance with the relevant national / international installation standards.

Make sure that the wires are well insulated from each other and do not cause any unintentional connections.

Intrinsically safe wiring (between the intrinsically safe circuit located in the hazardous area and the intrinsically safe circuit of the device) must have a minimum insulation thickness of 0.25 mm.

Typically, the device, as an accompanying device, should be mounted in a safe zone.

The device can be installed in a hazardous area "1, 2, 21, 22" and mine undergrounds only in Ex d (or other according to the applicable rules). In zone "2", based on the II 3G Ex ec IIC T4 (device category 3), it can be installed also on other rules described below in the environment of explosive mixtures with temperature class T1, T2, T3, T4 (with ignition temperature T > 135°C).

In the case of explosion group I (underground mines) after switching off the power supply, the device can be removed from the flameproof enclosure without time delay, unless placed on the cover's housing "Do not open the housing within 10 min. after turning off the power." In the case of using the device in the group II gaseous or group III dust explosion group, the device cannot be removed from the flameproof enclosure without a time delay and on the outside of the enclosure the warning sign should be placed: "Do not open the casing within 10 min after turning off the power."

In general cables and wires of intrinsically safe circuits should be led separately regarding to non-intrinsically safe cables and wires. If intrinsically safe cable is shielded and is blue it can be in cable trays together with other non-intrinsically safe cables. Shield of the cable should be connected to the ground PE only from one side e.g. only in safe zone with a wire of 2,5mm² diameter. Maintain a distance of 50mm from the end of the shield braid to the stripped ends of the cable cores in both the hazardous and safe zones (or use heat shrinking tubing). Put the crimping sleeves on the stripped ends of the cable cores. If in a multicore intrinsically safe cable are several intrinsically safe circuits the cables must be of A or B type with insulation test of 500V and the insulation cannot be thinner than 0.2mm. Cables and wires must be permanently fixed and protected against the possibility of mechanical damage. It is recommended to use blue cables. Compare the parameters Uo, Io, Po, Co, Lo, Ui, Ii, Pi, Ci, Li (L, C of the cable and Li, Ci of the device installed in the hazardous area).

If the L, C clustered parameters in the connected circuit (and this is how the Li, Ci parameters of the connected device should be treated) exceed 1% of the Lo, Co value, for the calculation should be taken of the Lo, Co parameters given in the certificate for the clustered values. If such parameters are not provided, then half of the Co, Lo value from the certificate should be taken for calculations with the assumption that the Co value cannot exceed 1  $\mu$ F for groups I, IIA, IIB and III and 0.6  $\mu$ F for IIC.

If a "simple device" made of plastic is installed in the hazardous area, the risk of electrostatics should be assessed. In the case of cable routes with high energy (power grid) or interferences, cables with measurement signals susceptible to the impact of interferences, apart from the use of shielded twisted-pair cables, should be led at a distance, e.g. in a separate tray, and the routes crossing each other should be at right angles.

#### For installation in zone 2:

- The housing provides a minimum degree of protection IP20. The device can be installed inside a building provided it is
  protected against dirt, dust, especially conductive dust, extreme mechanical exposures (eg vibrations, impacts, shocks),
  and thermal stress.
- 2) Installation outside the building requires an additional enclosure with a higher degree of protection minimum IP54 or higher, eg IP65, in accordance with the surrounding environment in which the installation operates. It may be an enclosure without an explosion-proof designation, but:
  - with the warning label "Caution: risk of electrostatic discharge" (see point 6).
  - provided that it will be mounted with protection against falls and mechanical impacts.
- 3) It is safest to install the device in zone 2, both inside and outside of the building, in an explosion proof enclosure (eg with an "Ex ec", "Ex e" protection level) providing a minimum IP54 protection degree or higher (eg IP65) in accordance with the surrounding environment in which the installation operates.
- 4) Regardless of the place of installation, the devices must be protected against dirt, dust, especially conductive dusts, extreme mechanical infections (eg vibrations, impacts, shocks) and thermal stress.
- 5) In order to prevent self-loosing of cables in non-intrinsically safe screw terminals numbers 9, 10, 11, 12, 13, 14, 15, 16, one should place non-tinned cables in each of the clamp:
  - a single wire or cable with a twisted tip with a cross-section of  $0.25 \div 2.5 \text{ mm}^2$ ,
  - 2 cables with the same cross-section of  $0.5 \div 1.5 \text{ mm}^2$  type wire with a twisted tip placed in a common tube sleeve with plastic crushed by a specialized tool.

Tighten the terminal firmly with a torque of 0.5 Nm (typically 2 kfg force on the handle of a screwdriver with a diameter of 2.5 cm) with a flat screwdriver 3.0...3.5 mm wide. Every 6 months, check the tightening of the terminals by tightening with a torque of 0.5 Nm using a screwdriver with a width of 3...3.5 mm.

- 6) If the housing needs cleaning, use a cloth lightly moistened with a mixture of detergent and water. Electrostatic hazard: to avoid the risk of electrostatic discharge, the casing of the device and / or the enclosure in which the device is installed should be cleaned only with a damp or antistatic cloth (soaked in antistatic liquid). Avoid any penetration of cleaning liquid into the interior to prevent damage to the device.
- 7) Non-intrinsically safe circuits (including 24Vdc power supply) must be connected to power suppliers and devices galvanically separated from the power grid (SELV or SELV-E circuits).
- 8) If an explosive atmosphere is present or can occur, non-intrinsically safe terminals numbers 9, 10, 11, 12, 13, 14, 15, 16 must not be connected to live cables or disconnectable connector blocks. If an explosive atmosphere is present or can occur during service work, disconnect all non-intrinsically safe connector blocks or disconnect these circuits in the safe area. If there is no explosive atmosphere during service work, the bove-mentioned principles from point 8 are not required.

# **FUNCTIONAL DESTRIPTION**

The device on the hazardous side has only RS485 interface. The consequence of this is operation only in half-duplex mode (alternate communication in both directions on a two-wire line).

The device has 3 operating modes.

In the first mode the baudrate is set using jumpers. The device reads individual bytes. If there is no continuation in the frame after the last byte, then after the end of the transmission the line is released after 3 bauds from the last stop bit. If a frame error is detected, then the device releases the line after approximately 15 to 20 bauds from the last recorded edge. This mode is recommended with a known fixed baudrate which is within the capabilities of the device. It is strongly recommended when high interference can be present.

In the second mode the baudrate jumpers are set to automatic transmission speed measurement. In this case, the device first measures the baudrate. The first frame and possibly the second may not be transmitted correctly. This manifests itself in a delay in the release time of the transmission line in the same way as in the case of an incorrect frame. After measuring the baudrate, the device reads individual bytes. If there I no continuation in the frame after the last byte, then after the end of the transmission the line is released after 3 bauds from the last stop bit. If a frame error is detected, then the device releases the line after approximately 15 to 20 bauds from the last recorded edge and goes into the baudrate measurement mode. Setting this mode is recommended in the lack of information about the baudrate or the baudrate is not specified in the set of baudrates that can be set with jumpers.

In the third mode the baudrate selecting jumpers are set to disable the automatic measurement and transmission speed analysis. In this case the device measures the duration of the levels (bauds). The transmission line is released after a time of 12 to 15 bauds. In this case it is possible to increase the line release time by an additional 12 bauds depending on the setting of the SV5A 6-7 jumper. The device treats each frame separately. In order for the device to work properly, it must be ensured that in each transmission frame there is at least one baud corresponding to the baudrate. This requirement is automatically met in the presence of strong polynominal-based checksums (e.g. CRC16 for MODBUS RTU, PROFIBUS DP etc.). This mode is recommended in the case of transmission separation in which each pair (query  $\rightarrow$  response) has a different transmission speed or transmission packets have gaps.

Transmission control is indicated by LEDs.

- LED PWR Steady light after power is on means correct operation and no defined baudrate.
- LED PWR Blinking with fast pulses after power is on means correct operation and baudrate set with jumpers. After few seconds it goes to steady light.
- LED PWR Flashing with slow pulses means connection line is damaged. The program detects a situation when there is no data bit after the start bit. The pulse is too long. The flashing is just a feedback, the device does not stop working. To eliminate this error change polarity of the connecting wires.
- ➤ LED RS Flashing during transmission in any direction.

# Configuration of the device.

The separator is equipped with optional attached internal  $300\Omega$  terminators matching the wave resistance of the line. After opening the housing and disconnecting 24V supply can be set:

SV5A	Description of the jumpers configuration.
1-2	Shorting – echo block (for RS232 on safe side) Opening – echo block circuit is switched off
2-3	Shorting – enables transmission direction control on the side of the safe zone.  Opening – disables transmission control. Transmitter is permanently switched on.  Opening for RS232 on safe side.
4-5	Shorting – standard on safe zone is RS232. Opening – standard on safe zone is RS485 or RS422.
6-7 <sup>3</sup>	Shorting – additional parity bit is transmitted. For 8O1, 8O2, 8E1, 8E2 <sup>4</sup> . Opening – for 7N2, 7O1, 7O2, 7E1, 7E2, 8N1, 8N2.
6-7 <sup>5</sup>	Shorting – additional elongation of line releasing by 15 bauds.  Opening – no elongation.
8-9	Shorting – in RS485 transmission on safe side only terminals 15 and 16 are used.  Opening – typical RS422 connection. In case of RS485 on safe side additional terminals (11-15 and 12-16) shorting is needed.

SV5	Description of the jumpers configuration.
1-2	Shorting – connects the internal terminator to Y/Z line.  Opening – disconnects the terminator of Y/Z line.
3-4 5-6 7-8	Configuration jumpers storage.

		SV7A	Setting baudrate and transmission	
1-2	3-4	5-6	Jumpers view	analysis
opened	opened	opened	123456	9600 bd
opened	opened	shorted	123456	14400 bd
opened	shorted	opened	123456	19200 bd
opened	shorted	shorted	123456	38400 bd
shorted	opened	opened	123456	57600 bd
shorted	opened	shorted	123456	15200 bd
shorted	shorted	opened	123456	Automatic baudrate measuring
shorted	shorted	shorted	123456 (171717)	Transmission analysis turned off

 $<sup>^3</sup>$  Jumper operates in this mode if transmission analysis is turned ON.  $^4$  7,8 – bits number, N – no parity bit, O – odd parity, E – even parity, 1 – 1 stop bit, 2 – 2 stop bits  $^5$  Jumper operates in this mode if transmission analysis is turned OFF.


Safe side	Device connecting description	External connecting description
RS232	SV5A 6-7 short. SV5A 4-5 open. SV5A 3-4 short	DB9 – Female (example) TxD – DB9-2 RxD – DB9-3 GND – DB9-5
RS485	SV5A 6-7 open SV5A 4-5 short	A short with $Y \Rightarrow$ bidirectional signal A of RS485 line B short with $Z \Rightarrow$ bidirectional signal B of RS485 line (optionally T-B connected to B – internal terminator)
RS422	SV5A 6-7 open SV5A 4-5 short (open option) SV5 1-2 (short option for terminator)	$A \Rightarrow signal\ A$ , $B \Rightarrow signal\ B$ (optionally T-B connected to B – internal terminator) $Y \Rightarrow signal\ Y, Z \Rightarrow signal\ Z$

Hazardous side	Device connecting description	External connecting description
RS485	SV5A 1-2 short	A1 ⇒ signal A of RS485 line B1 ⇒ signal B of RS485 line (optionally T-B1 connected to B1 – internal terminator)

# Example of use of terminators

Connecting without noise filter

Connecting with noise filter. Only on the safe zone. Use in case of interference generators nearby e.g. high power electric engines, turbine, induction furnace. It can be ordered from LABOR-ASTER after consultancy.



$$C = \frac{1}{2 * \pi * BaudRate * R_T}$$

$$BaudRate - \text{transmission speed in bods.}$$

ORDERING CODE: Converter-separator type S2Ex-RS-Z-Y v.Ex485

where Z=(1, 2, 3, 4, 5) according to the table from page 2 (column "Version") Y=(A,B,C,CH,E) according to the table below

Y parameter in ordering code is optional because it can be changed by user with jumpers

	Safe zone - Y
RS232 without echo	A
RS232 echo	В
RS485	C
RS485 2-wires	СН
RS422 half-duplex with terminator	Е

ORDER EXAMPLE: Transmission separator with RS485 on hazardous side and RS422 on safe side, with safety parameters Uo=5V, Io=159mA, Po=195mW:

typ: S2Ex-RS-3-E v.Ex485

Production and distribution: LABOR – ASTER

Poland, 04-218 Warsaw, ul. Czechowicka 19 tel. +48 22 610 71 80; +48 22 610 89 45


e-mail: biuro@labor-automatyka.pl http: www.labor-automatyka.pl

The manufacturer reserves the right to make changes to the product. Edit. 11 / 2025


# Detailed description of connection and configuration of each version.

Below description concerns ordered version and its connection. User can change his device version basing on below drawings (after demounting it and opening the housing). Most popular versions are marked on green. During inactive state of transmission lines A Y A1 Y1 have positive voltage in relation to their equivalent B Z B1 Z1 while voltmeter is between transmission terminals (couples: A B, A1 B1, Y Z, Y1 Z1). Producers have different interpretation of A and B lines. In case of troubles with transmission it is worth to try to swap these lines.

Connection between S2Ex-RS and master computer in version with RS-232 interface for two types of connectors. Other connection are shown in the end of this document.




Dotted line is for optional connections for 2-wire version.



Code	Description	Jumpers description <sup>6</sup>	Hazardous zone Connection drawing Safe zone
S2Ex-RS-Z'-A v.Ex485	RS232⇔RS485 Transmission with echo suppression. Half-duplex transmission.	SV5A 1-2 shorted SV5A 4-5 shorted 123456789 SV5A 2468 SV5 1357	8 A1 RS232 TxD Gnd 9 Gnd Gnd 9 Gnd TxD TxD 15 RxD TxD 14
S2Ex-RS-Z-B v.Ex485	RS232⇔RS485 Transmission with listening (echo) A1 B1 line. Half-duplex transmission. Wrong echo indicates a conflict in the RS485 line.	SV5A 4-5 shorted  123456789  SV5A  2468  1357	8 A1 RxD 12 TxD 15 RxD Gnd 9 Gnd TxD 15 RxD 15 RxD 14

<sup>&</sup>lt;sup>6</sup> Jumper SV5A 8-9 should be used in case of discontinuous transmission. This jumper does not affect function of the device described in the table. It affects time after transmission line is released.

<sup>&</sup>lt;sup>7</sup> In this case parameter Z refers to intrinsically safe version of the device Z=(1, 2, 3, 4, 5). It is described in tabel on page 2 (columny "Version"). It does not affect the transmission configuration of the device which is shown in this table.

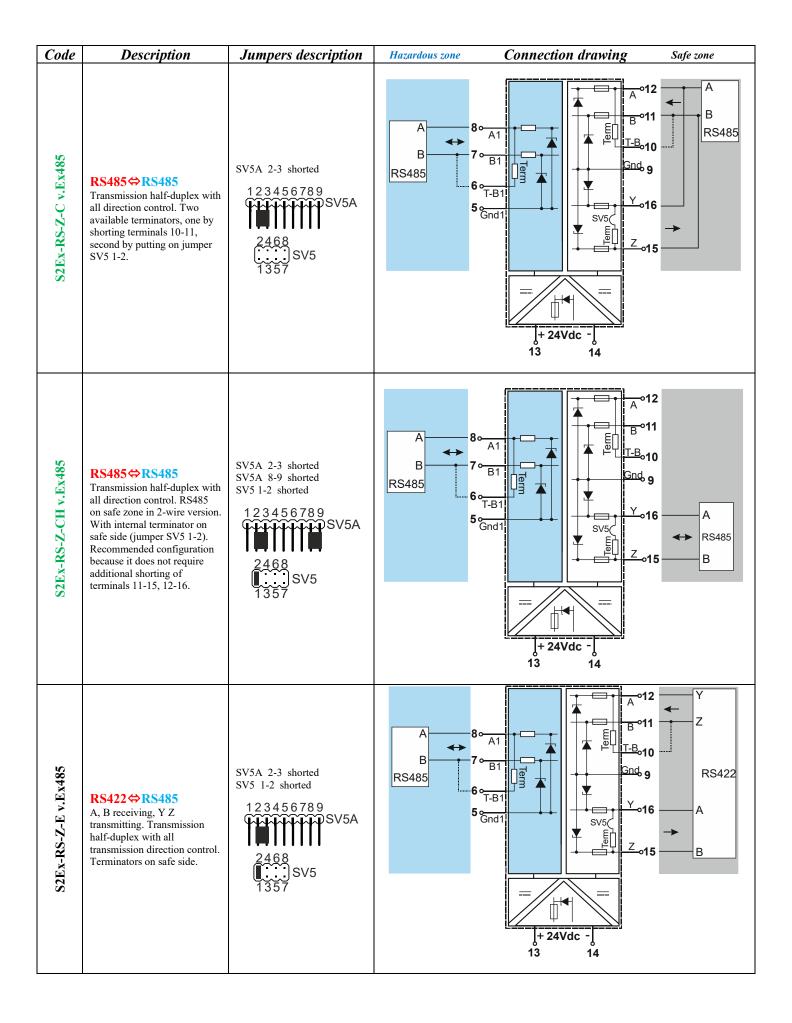

Below is a detailed table of RS232C interface connections from the device to the standards of the different companies. In order to ensure correct operation of the transmission control signals should be shorted. The table is for reference only. In order to determine the final connection, the following connections should be compared to the catalog data of the connected device.

Connection type → Company name →		TER					8P8C (RJ45 ) 10P10C (RJ50								J50)	
Signal name	Sym	Direction	LABOR-ASTER S2Ex-RS	DB-25M	DB-25F	DB-9M	DB-9F	TIA-561	Yost	MMJ	Cisco	Hirschmann	Cyclades	National Instruments	Cyclades	Digi
Common Ground	G		GND	7	7	5	5	4	4-5	3-4	4-5	4	4	6	5	7
Transmitted Data	TxD	$\rightarrow$	TxD	2	3	3	2	6	3	2	3	3	3	8	4	5
Received Data	RxD	<b>←</b>	RxD	3	2	2	3	5	6	5	6	5	6	9	7	6
Data Terminal Ready	DTR	$\rightarrow$	ted	20	6	4	6	3	2	1	2	-	2	7	3	9
Data Set Ready	DSR	<b>←</b>	Shorted	6	20	6	4	1	7	6	7	-	8	5	9	2-10
Carrier Detect	DCD	<b>←</b>		8	-	1	-	2	7	-	-	-	7	10	8	10-2
Request To Send or Ready to Receive	RTS RTR	$\rightarrow$	Shorted	4	5	7	8	8	1	-	-	-	1	4	2	3
Clear To Send	CTS	<b>←</b>	S	5	4	8	7	7	8	-	-	-	5	3	6	8
Ring Indicator	RI	<b>←</b>		22	(NC)	9	-	1	-	-	-	-	-	2	10	1

Note. No Connect (NC) – leave unconnected. Empty fields (-) in the table mean signal is not used.

Separator is placed in a housing made of self-extinguishing plastic (polyamide PA 6.6) intended for mounting on TS35 rail. The enclosure and terminal protection degree is IP20.

# **Operational conditions:**

Ambient temperature – storage $-30 \div +70^{\circ}$ CAmbient temperature – operation $-30 \div +70^{\circ}$ CRelative humiditymax 90% no condensationAmbient atmosphereno aggressive dusts and gasesOperation positionany